


- NOTE NO. 1 - MANHOLE CASTING AND COVER SHALL BE AS DEFINED IN SECTION 1205-2.5.
- NOTE NO. 2 - CRETEX 48" TYPE II COVER
- NOTE NO. 3 - MANHOLE CASTING ADJUSTMENT - SEE STANDARD DETAIL NO. 1206-1.
- NOTE NO. 4 - 2" STYROFOAM INSULATION SHALL BE AS DEFINED IN SECTION 901-3.13 INSTALLED AROUND THE OUTSIDE OF THE TOP 4 FEET OF THE MANHOLE AND HELD IN PLACE BY BANDS OR GLUE UNTIL BACKFILLED.
- NOTE NO. 5 - CRETEX P2 GASKETED JOINT FOR 48" MANHOLES, CRETEX CX-4 JOINT FOR ALL OTHER SIZES OF MANHOLES OR EXTERIOR SEAL BY PRESS-SEAL GASKET CORP. EZ WRAP AND EZ STIK NO. 4 PRIMER, CRETEX SPECIALTY PRODUCTS "MAC WRAP", OR AN APPROVED EQUAL.
- NOTE NO. 6 - INSTALL 2" STYROFOAM INSULATION AS DEFINED IN SECTION 901-3.13 GLUED TO THE BOTTOM OF THE PRECAST COVER.
- NOTE NO. 7 - 2" OPENING SHALL BE LEFT AROUND PIPE AND FILLED WITH KENTSEAL OR AN APPROVED EQUAL.
- NOTE NO. 8 - 1" AUTOMATIC AIR RELEASE VALVE - SEE SECTION 1205-2.9
- NOTE NO. 9 - SEAL WITH KENTSEAL OR AN APPROVED EQUAL.
- NOTE NO. 10 - SEE SECTION 1205-2.9 FOR PRECAST MANHOLE BASE REINFORCEMENT.
- NOTE NO. 11 - I/I BARRIER WITH CAP 'N SEAL AS MANUFACTURED BY AP/M PERMAFORM OR AN APPROVED EQUAL.
- NOTE NO. 12 - STEPS SHALL NOT BE PLACED IN SANITARY SEWER, STORM SEWER OR AIR RELEASE MANHOLES OR INLETS UNLESS SPECIFIED. IF SPECIFIED, THE MANHOLE STEPS SHALL BE DELTA SUREFOOT OR APPROVED EQUAL. STEPS SHALL BE SPACED 16" ON CENTER.

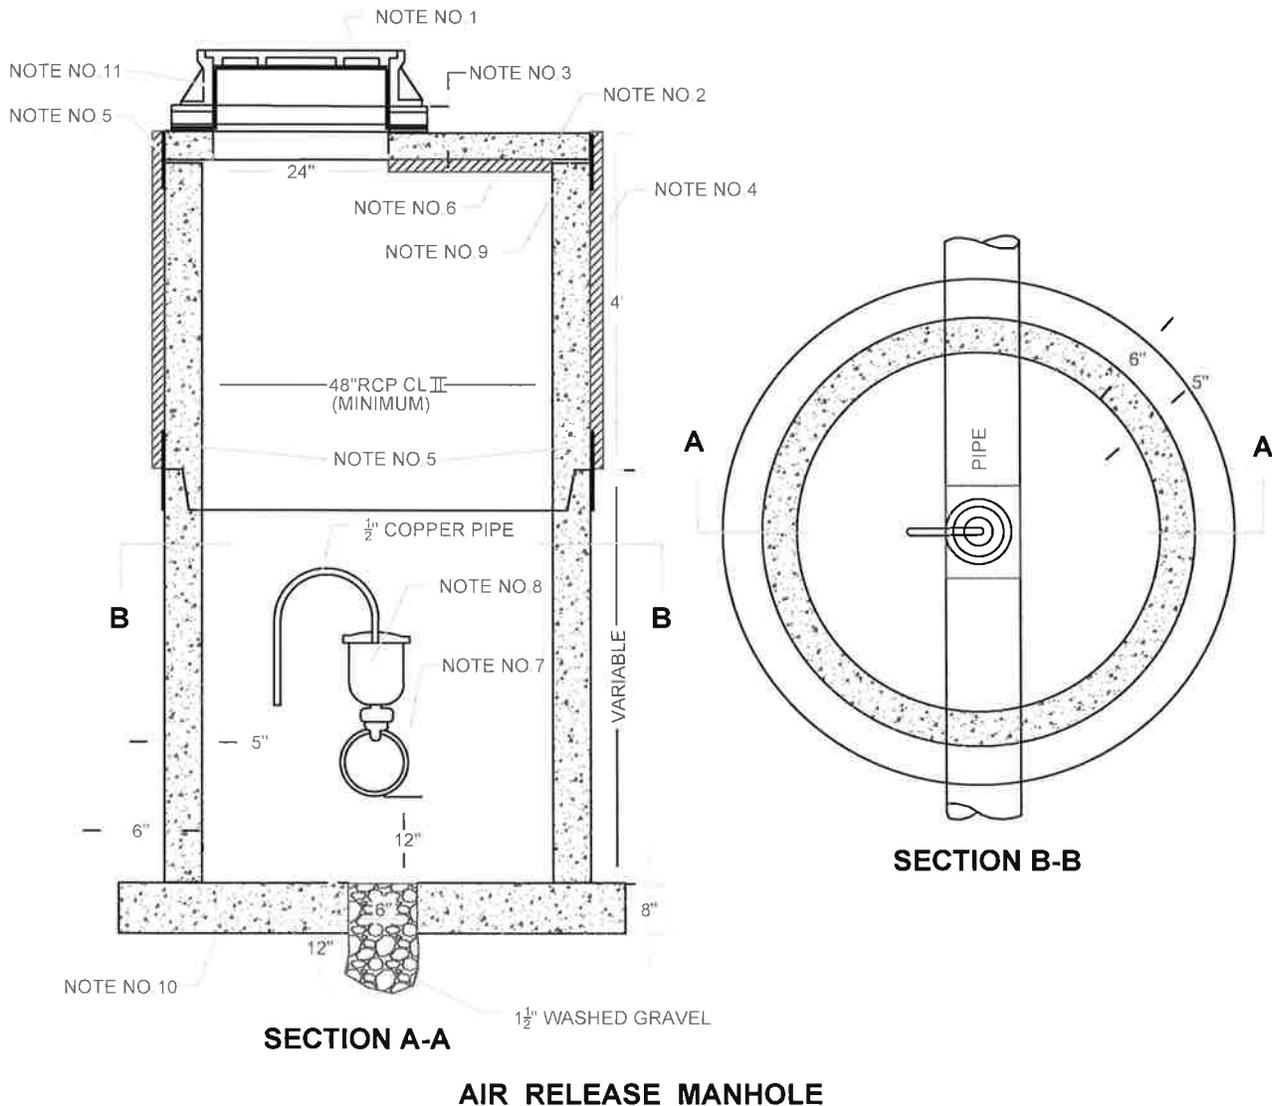

| | |
|--------------------------|---------|
| Scale | Sheet # |
| NTS | 1 of 1 |
| Date | |
| 04/07/2015 | |
| File Name | |
| Construction Details.dwg | |

DISCLAIMER

The specifications represented in this document are in accordance with established City of Mandan Engineering & Planning practices and are an electronic facsimile of the specifications on file in the City of Mandan Engineering & Planning Department. However, neither the City of Mandan nor its employees can or do warranty these specifications to be complete specifications for any or all construction projects. The specification document, together with all addendums listed in each construction project specification, shall be the project specification for the City of Mandan. The user acknowledges and accepts all the data "as is", including the fact that the details are under a constant state of maintenance, correction and revision.

1312 AIR RELEASE MANHOLE

